

Statistics

	Average	Maximum	Minimum	Max/Min	Avg/Min
INFIELD	52.5	66	38.6	1.7	1.4
OUTFIELD	30.1	45.3	19	2.4	1.6




One Lithonia Way Conyers, GA 30012

These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

Luminaire Schedule

Symbol	Qty	Catalog No.	Lamp	Initial Lumens
N	24	ASPX5M GN	MH1500/BU-HOR	151900
M	16	ASPX5M GM	MH1500/BU-HOR	151900
W	8	ASPX5M GW	MH1500/BU-HOR	151900

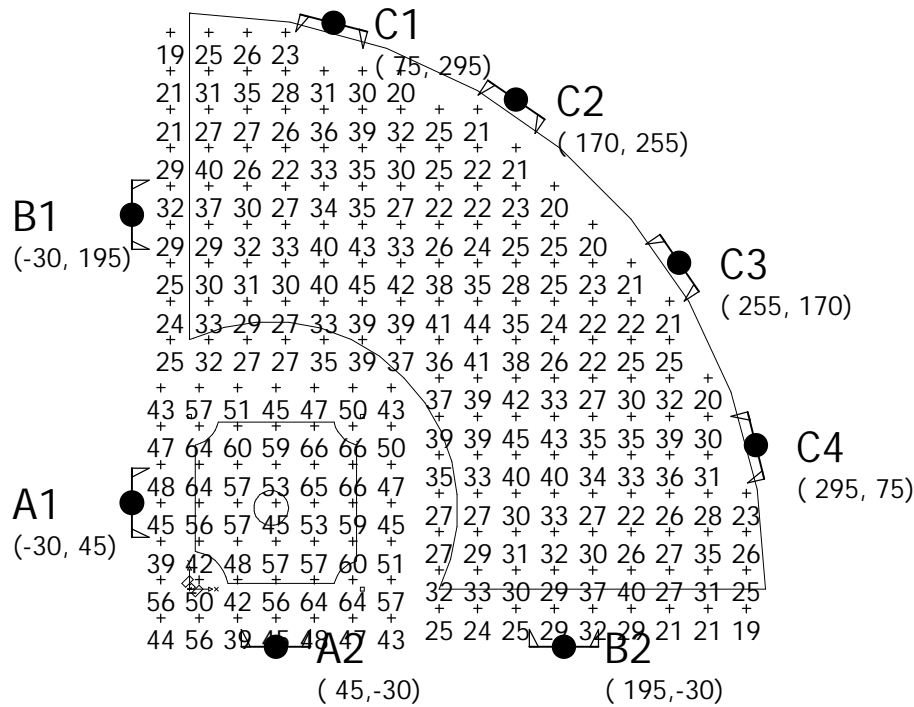

Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .80
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) ~~Levels based on rated input voltage supplied to ballast~~

Luminaire Legend

Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	8	26.4	12.88	60
A2	8	26.4	12.88	60
B1	7	23.1	11.27	70
B2	7	23.1	11.27	70
C1	4	13.2	6.44	70
C2	5	16.5	8.05	70
C3	5	16.5	8.05	70
C4	4	13.2	6.44	70

Drawing Number:	BB853AS	Drawn By:	
		Approved:	
Sheet 1 of 1		Date: 10/13/03	
		Scale: 1 Inch = 100 Feet	

TYPICAL 300FT BASEBALL FIELD
8 POLE 50/30FC LAYOUT