

Statistics

	Average	Maximum	Minimum	Max/Min	Avg/Min
TENNIS	32.8	41.2	17.8	2.3	1.8
IN_LINES	37	41.2	31.1	1.3	1.2



One Lithonia Way Conyers, GA 30012


These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

Luminaire Schedule

Symbol	Qty	Catalog No.	Lamp	Initial Lumens
W	12	ASPX1M GW	MH1000/U	107800

A3

A1

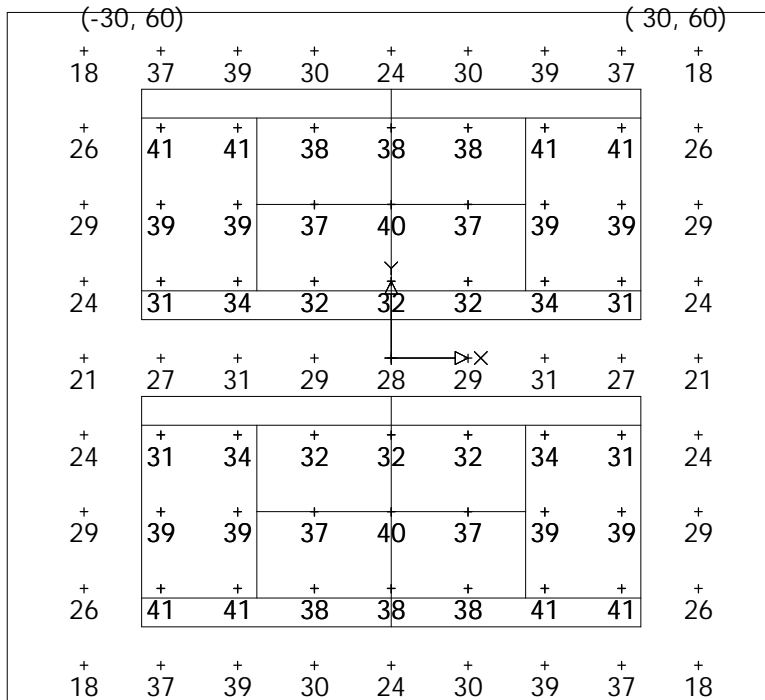

Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .74
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) Levels based on rated input voltage supplied to ballast

Luminaire Legend

Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	3	9.9	3.24	30
A2	3	9.9	3.24	30
A3	3	9.9	3.24	30
A4	3	9.9	3.24	30

A4

A2

(-30,-60)

(30,-60)

Drawing Number:	Drawn By:
TN433AS	Approved:
Sheet 1 of 1	Date: 10/13/03
	Scale: 1 Inch = 30 Feet

TYPICAL TENNIS COURTS
4 POLE 30FC LAYOUT