

Statistics

	Average	Maximum	Minimum	Max/Min	Avg/Min
INFIELD	33.7	42.1	21.6	2	1.6
OUTFIELD	21.6	30.7	14.3	2.1	1.5



One Lithonia Way Conyers, GA 30012

These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

Luminaire Schedule


Symbol	Qty	Catalog No.	Lamp	Initial Lumens
N	28	ASPX5M GN	MH1500/BU-HOR	151900
M	8	ASPX5M GM	MH1500/BU-HOR	151900
W	2	ASPX5M GW	MH1500/BU-HOR	151900

Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .80
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) Levels based on rated input voltage supplied to ballast

Luminaire Legend

Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	6	19.8	9.66	60
A2	6	19.8	9.66	60
B1	6	19.8	9.66	70
B2	6	19.8	9.66	70
C1	7	23.1	11.27	70
C2	7	23.1	11.27	70

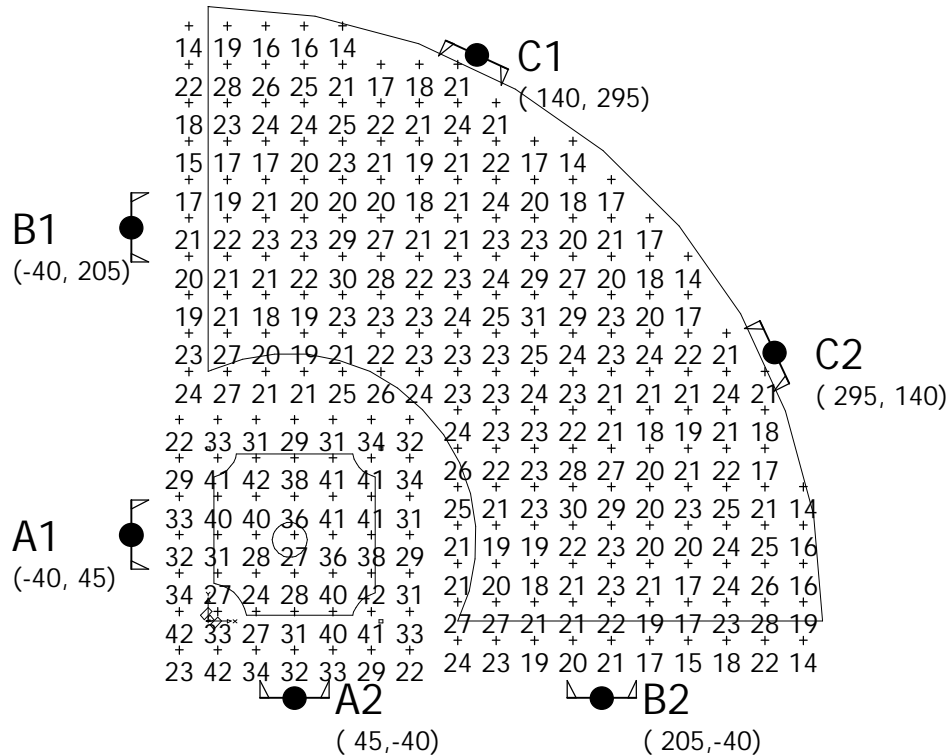

Drawing Number:	BB634AS	Drawn By:	Approved:
Sheet 1 of 1		Date: 10/13/03	Scale: 1 Inch = 100 Feet

TYPICAL 320FT BASEBALL FIELD
6 POLE 30/20FC LAYOUT