

Statistics

	Average	Maximum	Minimum	Max/Min	Avg/Min
INFIELD	54.5	70.1	38.8	1.8	1.4
OUTFIELD	31.3	49	21.9	2.2	1.4


These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

Luminaire Schedule

Symbol	Qty	Catalog No.	Lamp	Initial Lumens
N	30	ASPX5M GN	MH1500/BU-HOR	151900
M	10	ASPX5M GM	MH1500/BU-HOR	151900

Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .80
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) Levels based on rated input voltage supplied to ballast

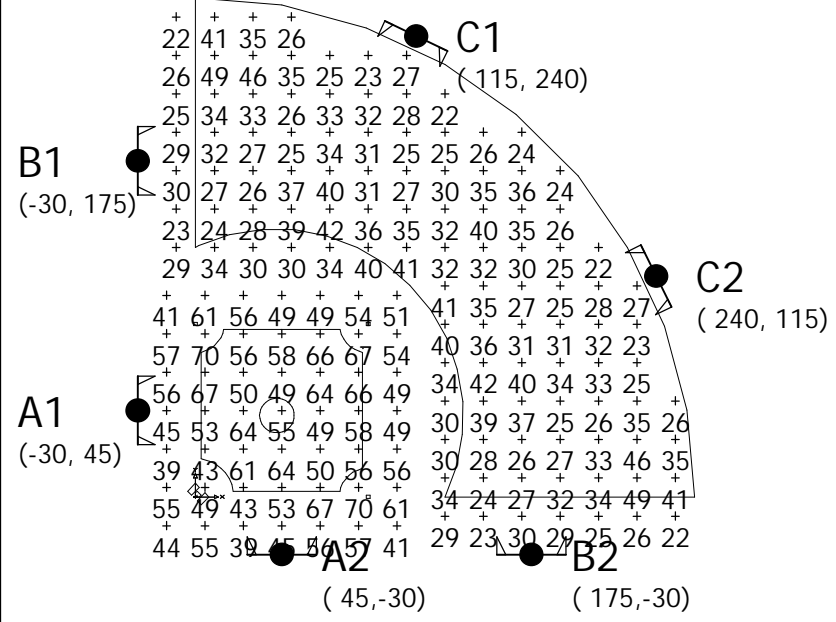

Luminaire Legend

Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	8	26.4	12.88	60
A2	8	26.4	12.88	60
B1	6	19.8	9.66	60
B2	6	19.8	9.66	60
C1	6	19.8	9.66	60
C2	6	19.8	9.66	60

Drawing Number:	BB651AS	Drawn By:	
		Approved:	
Sheet 1 of 1		Date: 10/13/03	
		Scale: 1 Inch = 100 Feet	

TYPICAL 260FT BASEBALL FIELD
6 POLE 50/30FC LAYOUT