

Statistics

	Average	Maximum	Minimum	Max/Min	Avg/Min
SOCCER	30.1	40.8	21	1.9	1.4



One Lithonia Way Conyers, GA 30012

These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

Luminaire Schedule


Symbol	Qty	Catalog No.	Lamp	Initial Lumens
N	28	ASPX5M GN	MH1500/BU-HOR	151900
M	4	ASPX5M GM	MH1500/BU-HOR	151900
W	12	ASPX5M GW	MH1500/BU-HOR	151900

Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .80
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) Levels based on rated input voltage supplied to ballast

Luminaire Legend

Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	7	23.1	11.27	70
A2	7	23.1	11.27	70
A3	7	23.1	11.27	70
A4	7	23.1	11.27	70
B1	8	26.4	12.88	70
B2	8	26.4	12.88	70

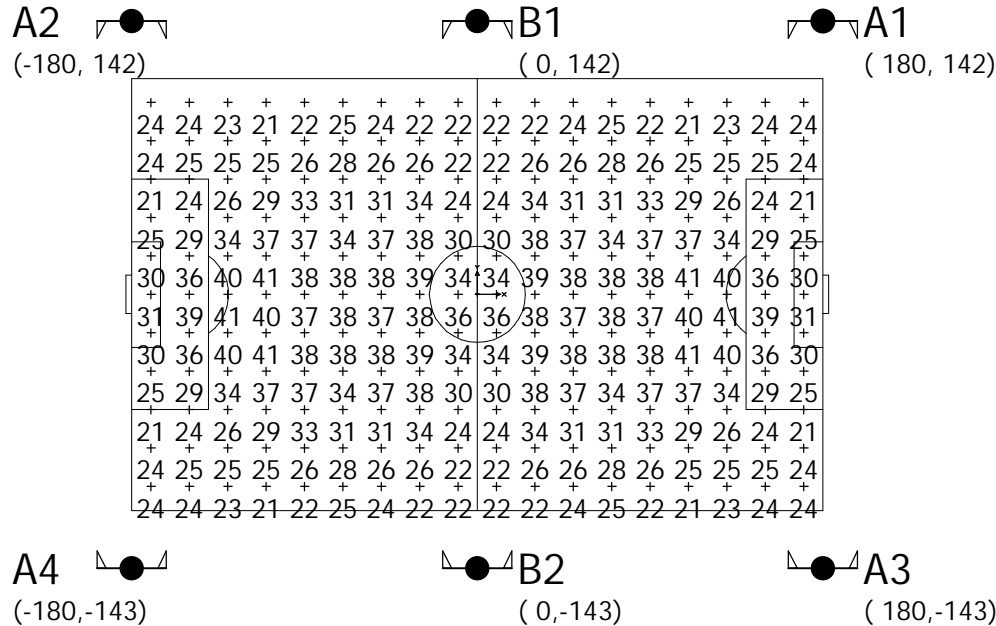

Drawing Number:	Drawn By:
SCC633AS	Approved:
Sheet 1 of 1	Date: 10/13/03
	Scale: 1 Inch = 100 Feet

TYPICAL 225 X 360 SOCCER FIELD
6 POLE 30FC LAYOUT