

### Statistics

	Average	Maximum	Minimum	Max/Min	Avg/Min
INFIELD	50.5	66.8	36.3	1.8	1.4
OUTFIELD	30.2	45	17.1	2.6	1.8

These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

### Luminaire Schedule


Symbol	Qty	Catalog No.	Lamp	Initial Lumens
N	8	ASPX5M GN	MH1500/BU-HOR	151900
M	10	ASPX5M GM	MH1500/BU-HOR	151900
W	4	ASPX5M GW	MH1500/BU-HOR	151900

### Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .80
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) Levels based on rated input voltage supplied to ballast

### Luminaire Legend

Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	6	19.8	9.66	60
A2	6	19.8	9.66	60
B1	5	16.5	8.05	60
B2	5	16.5	8.05	60

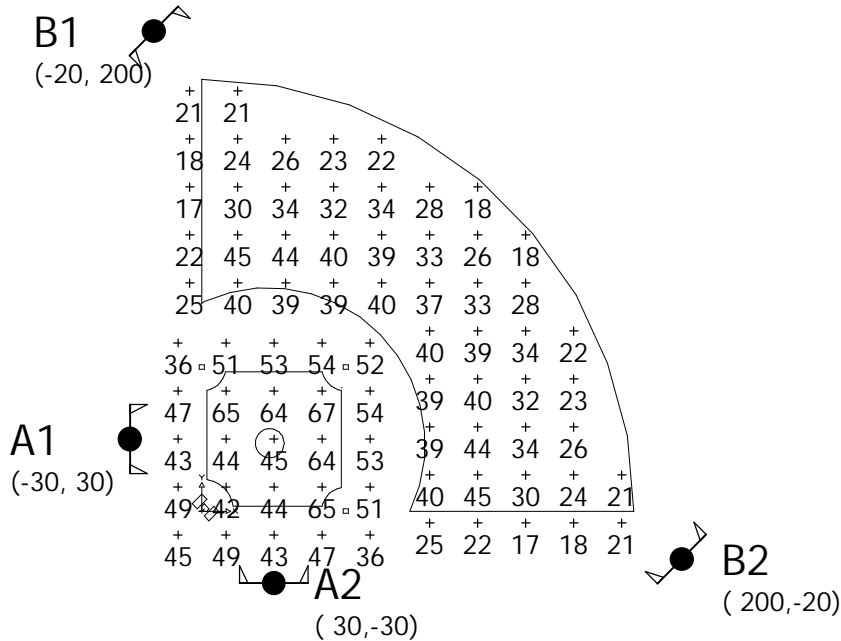

Drawing Number:

SB452AS

Sheet 1 of 1

Drawn By:

Approved:

Date: 10/13/03

Scale: 1 Inch = 80 Feet

**TYPICAL 180FT SOFTBALL FIELD**

4 POLE 50/30FC LAYOUT