

Statistics

	Average	Maximum	Minimum	Max/Min	Avg/Min
INFIELD	30.7	39.2	24.5	1.6	1.3
OUTFIELD	20.1	28.9	12.2	2.4	1.6



One Lithonia Way Conyers, GA 30012

These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

Luminaire Schedule


Symbol	Qty	Catalog No.	Lamp	Initial Lumens
M	12	ASPX5M GM	MH1500/BU-HOR	151900
W	12	ASPX5M GW	MH1500/BU-HOR	151900

Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .80
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) Levels based on rated input voltage supplied to ballast

Luminaire Legend

Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	3	9.9	4.83	50
A2	3	9.9	4.83	50
B1	5	16.5	8.05	60
B2	5	16.5	8.05	60
C1	4	13.2	6.44	60
C2	4	13.2	6.44	60

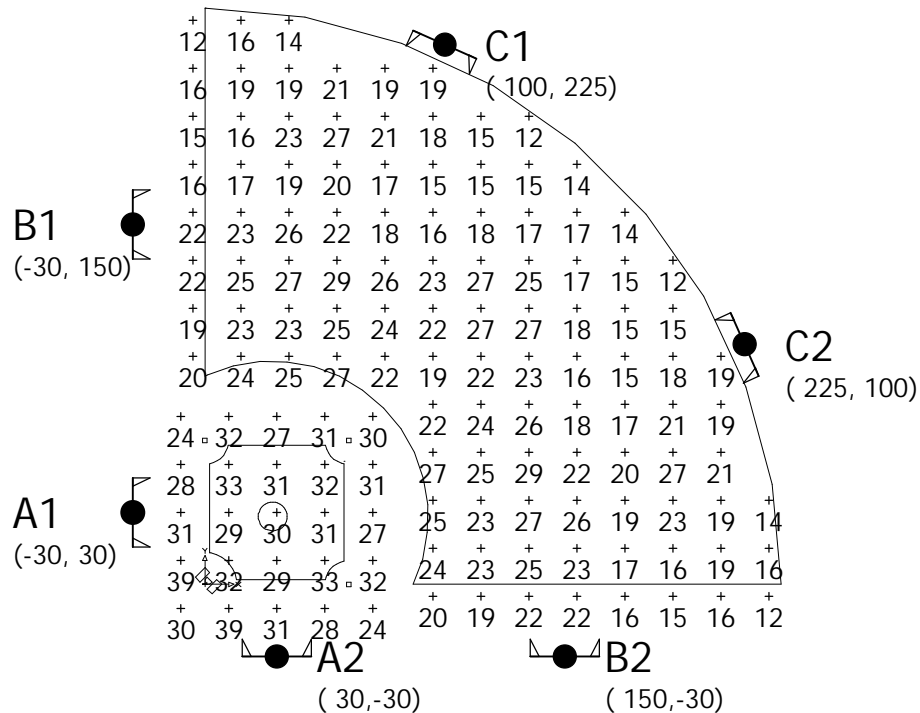

Drawing Number:	Drawn By:
SB634AS	Approved:
Sheet 1 of 1	Date: 10/13/03
	Scale: 1 Inch = 80 Feet

TYPICAL 240FT SOFTBALL FIELD
6 POLE 30/20FC LAYOUT