

## Statistics

	Average	Maximum	Minimum	Max/Min	Avg/Min
INFIELD	32.5	37.6	22.6	1.7	1.4
OUTFIELD	21.4	32.1	13.2	2.4	1.6



One Lithonia Way Conyers, GA 30012

These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

## Luminaire Schedule


Symbol	Qty	Catalog No.	Lamp	Initial Lumens
N	12	ASPX5M GN	MH1500/BU-HOR	151900
M	2	ASPX5M GM	MH1500/BU-HOR	151900
W	12	ASPX5M GW	MH1500/BU-HOR	151900

## Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .80
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) Levels based on rated input voltage supplied to ballast

## Luminaire Legend

Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	3	9.9	4.83	60
A2	3	9.9	4.83	60
B1	4	13.2	6.44	70
B2	4	13.2	6.44 <td 70	
C1	3	9.9	4.83	70
C2	3	9.9	4.83	70
C3	3	9.9	4.83	70
C4	3	9.9	4.83	70

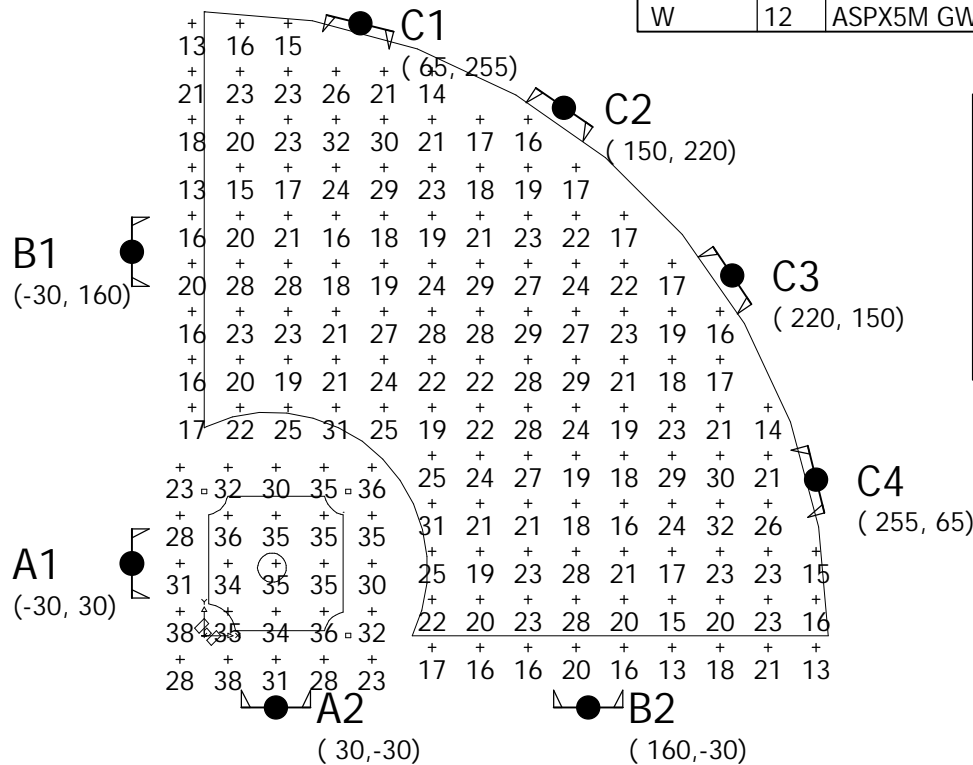

Drawing Number:	Drawn By:
SB835AS	Approved:
Sheet 1 of 1	Date: 10/13/03
	Scale: 1 Inch = 80 Feet

**TYPICAL 260FT SOFTBALL FIELD**  
8 POLE 30/20FC LAYOUT