

Statistics					
	Average	Maximum	Minimum	Max/Min	Avg/Min
TENNIS	64.7	78.9	54.5	1.4	1.2
IN_LINES	64.7	78.9	55.9	1.4	1.2




One Lithonia Way Conyers, GA 30012

These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

### Luminaire Schedule

Symbol	Qty	Catalog No.	Lamp	Initial Lumens
M	8	ASPX1M GM	MH1000/U	107800
W	16	ASPX1M GW	MH1000/U	107800

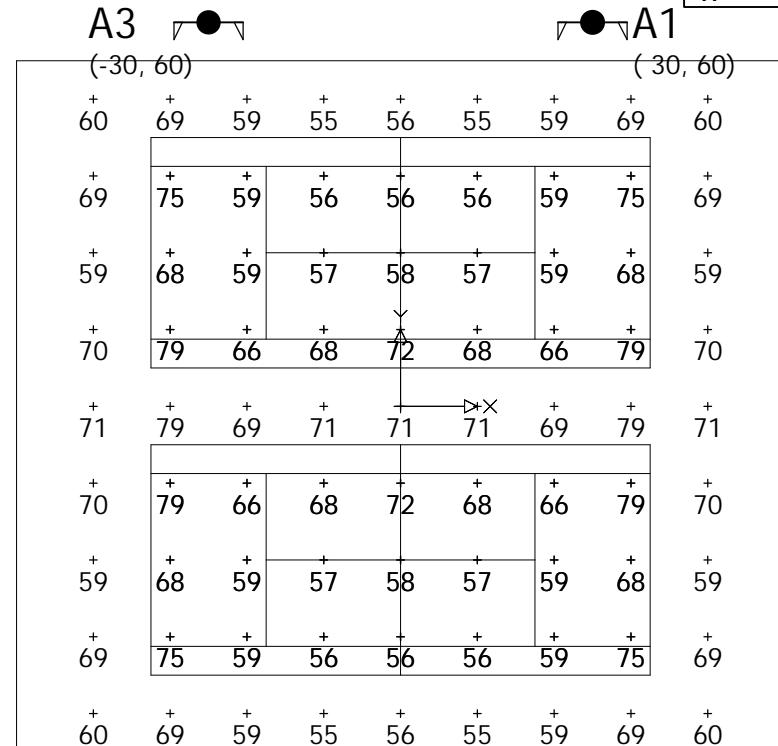

### Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .74
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) Levels based on rated input voltage supplied to ballast

### Luminaire Legend

Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	6	13.2	6.48	40
A2	6	13.2	6.48	40
A3	6	13.2	6.48	40
A4	6	13.2	6.48	40

A4      A2  
(-30,-60)      ( 30,-60)

Drawing Number: <b>TN463AS</b>	Drawn By:
Approved:	Date: 10/13/03
Sheet 1 of 1	Scale: 1 Inch = 30 Feet

**TYPICAL TENNIS COURTS**  
4 POLE 60FC LAYOUT