

Statistics

	Average	Maximum	Minimum	Max/Min	Avg/Min
TENNIS	63.7	82.1	40.3	2	1.6
IN_LINES	68.6	82.1	58.8	1.4	1.2



One Lithonia Way Conyers, GA 30012


These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

Luminaire Schedule

Symbol	Qty	Catalog No.	Lamp	Initial Lumens
M	16	ASPX1M GM	MH1000/U	107800
W	16	ASPX1M GW	MH1000/U	107800

Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .74
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) Levels based on rated input voltage supplied to ballast

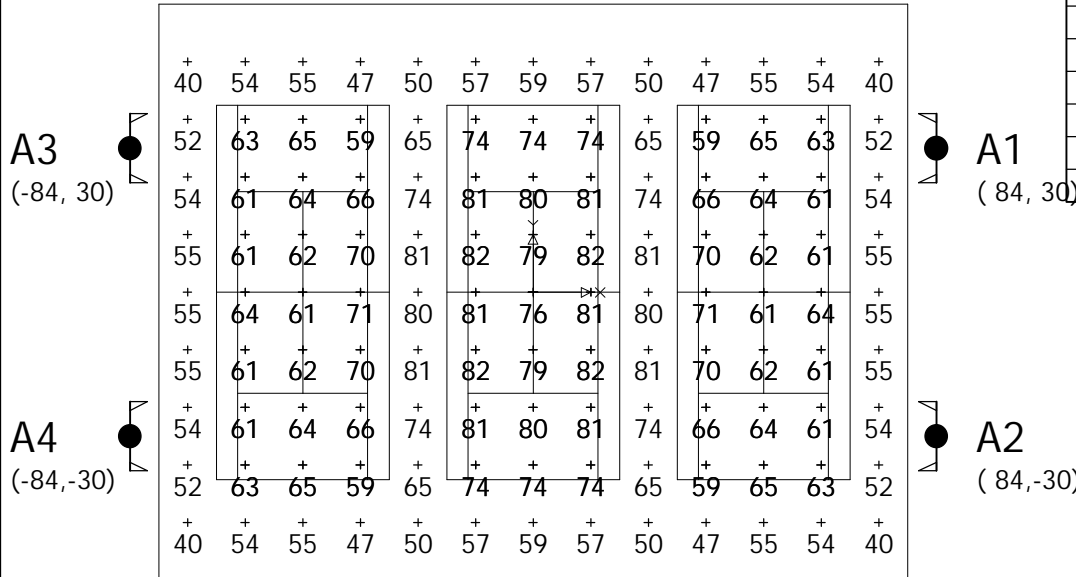

Luminaire Legend

Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	8	13.2	8.64	50
A2	8	13.2	8.64	50
A3	8	13.2	8.64	50
A4	8	13.2	8.64	50

Drawing Number:	Drawn By:
TN464AS	Approved:
Sheet 1 of 1	Date: 10/13/03
	Scale: 1 Inch = 40 Feet

TYPICAL TENNIS COURTS
4 POLE 60FC LAYOUT