

Statistics					
	Average	Maximum	Minimum	Max/Min	Avg/Min
TENNIS	57.1	71.7	33.2	2.2	1.7
IN_LINES	61.4	71.5	50.4	1.4	1.2



One Lithonia Way Conyers, GA 30012


These lighting calculations are not a substitute for an independent engineering analysis of lighting system suitability and safety.

Luminaire Schedule

Symbol	Qty	Catalog No.	Lamp	Initial Lumens
N	12	ASPX1M GN	MH1000/U	107800
M	12	ASPX1M GM	MH1000/U	107800
W	12	ASPX1M GW	MH1000/U	107800
NF	12	ASPX1M GF	MH1000/U	107800
MF	12	ASPX1M GF	MH1000/U	107800

Notes

- 1) Levels shown are maintained horizontal illuminance.
- 2) Based on a light loss factor of .74
- 3) Results are shown in units of footcandles.
- 4) Levels shown are taken 3 Feet above grade.
- 5) Includes effects of lamp operating position.
- 6) EPA does not include bracketry
- 7) Levels based on rated input voltage supplied to ballast

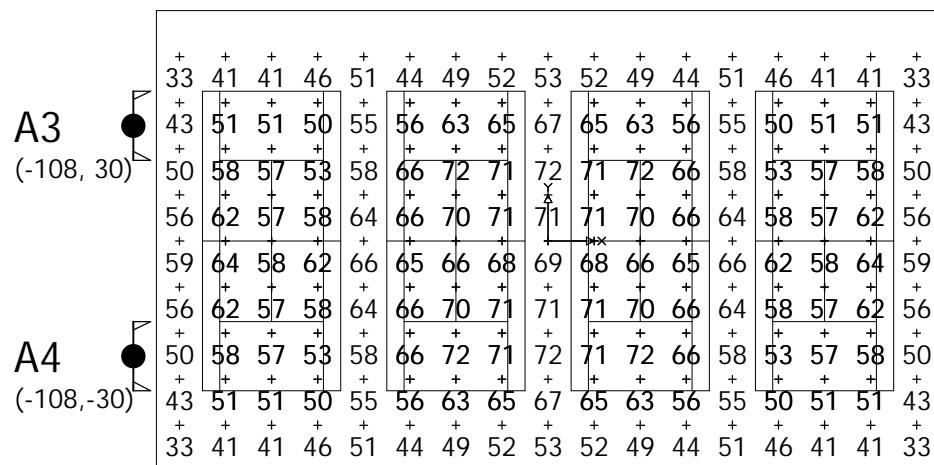

Luminaire Legend				
Pole	Quantity	EPA[FT SQ]	Power[KVA]	Height
A1	15	9.9	16.2	60
A2	15	9.9	16.2	60
A3	15	9.9	16.2	60
A4	15	9.9	16.2	60

Drawing Number:

TN465AS

Sheet 1 of 1

Drawn By:

Approved:

Date: 10/13/03

Scale: 1 Inch = 50 Feet

TYPICAL TENNIS COURTS
4 POLE 60FC LAYOUT